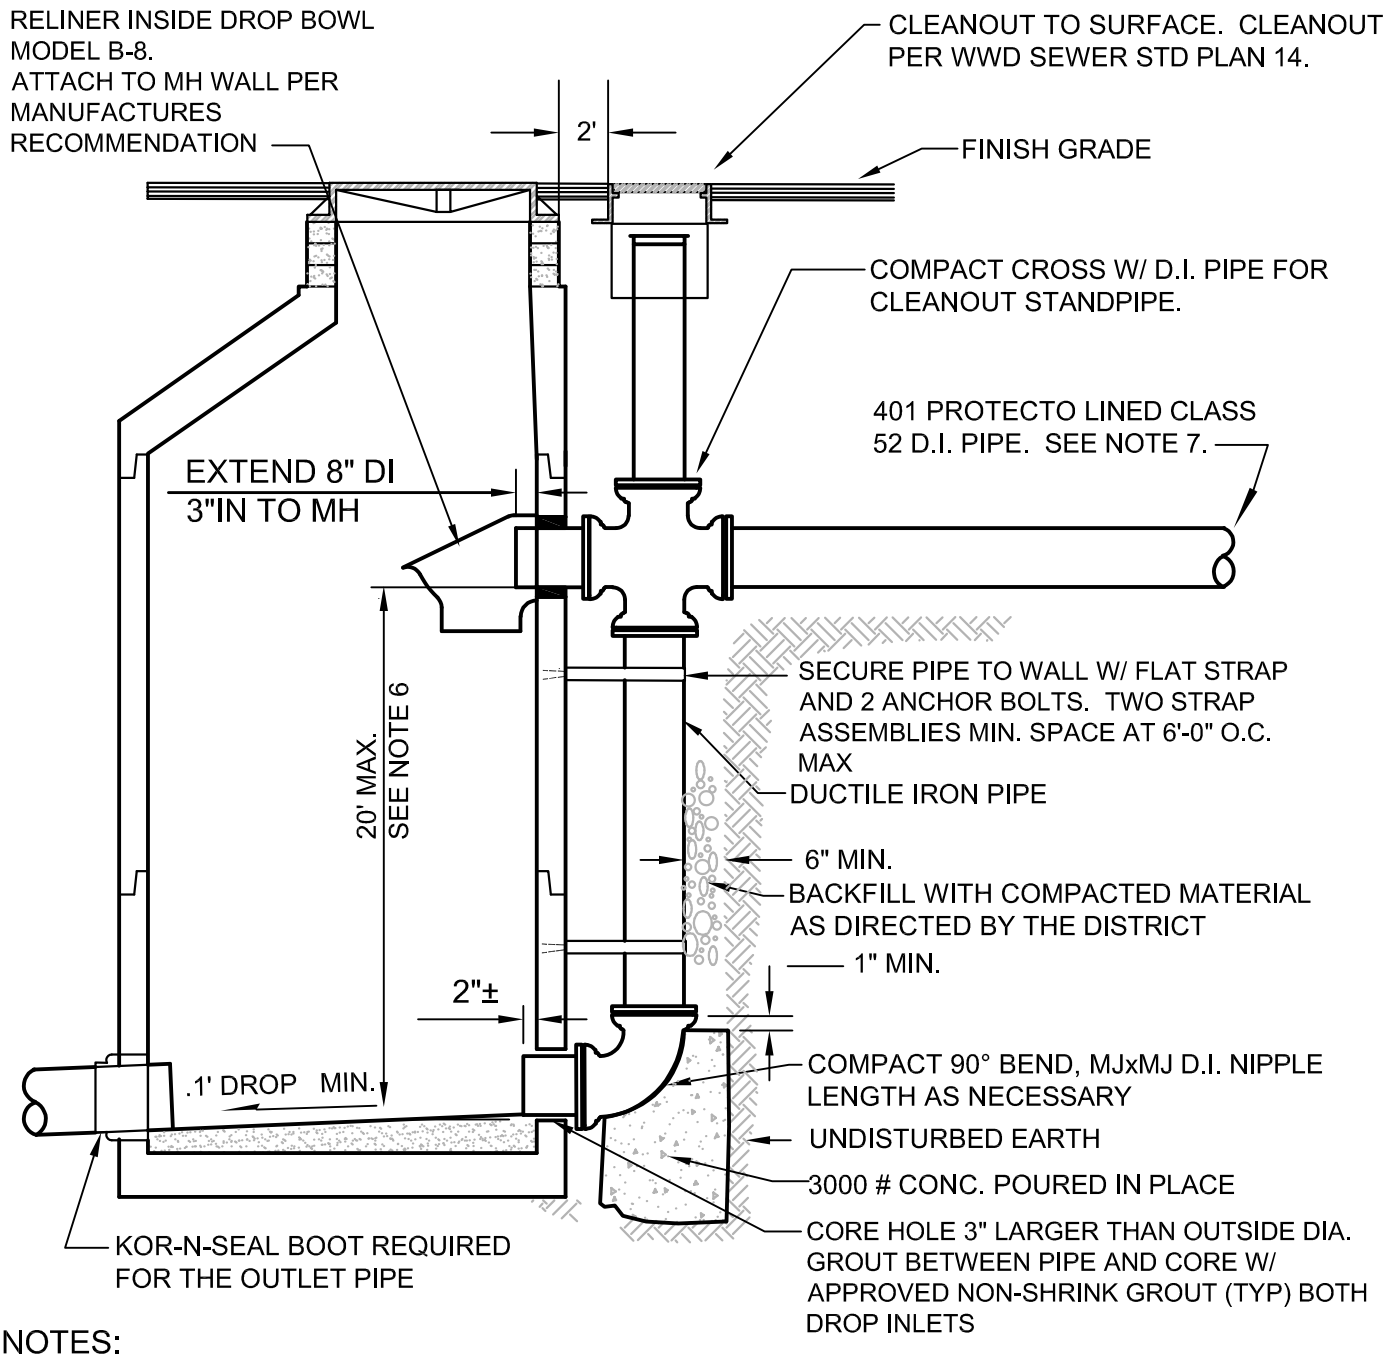

NOTES:

1. ALL APPLICABLE DETAILS FROM STANDARD PLAN NO. 2 APPLY TO DROP MANHOLE
2. WHEN POSSIBLE, LOCATE STEPS AND LADDER APPROX. 1' FROM DROP INLETS.
3. ALL MJ JOINTS SHALL BE MEG-A-LUG OR EQUAL.
4. CORED HOLE FOR DROP SHALL BE A MINIMUM OF 6" (EDGE TO EDGE) FROM A RISER SEAM.
5. DETAIL FOR 8" DIAMETER ONLY. OTHER SIZES BY DISTRICT APPROVAL ONLY.
6. MANHOLES DEEPER THAN 20' SHALL BE CONSTRUCTED PER THE REQUIREMENTS FOR DEEP MANHOLE STANDARD PLAN 5A. SUBMITTAL SKETCH OF PLATFORM AND DROP LOCATION REQUIRED.
7. 401 PROTECTO LINED CLASS 52 DUCTILE IRON PIPE SHALL BE INSTALLED FROM THE DROP LOCATION TO THE NEXT UPSTREAM MANHOLE.

Woodinville Water District	8" OUTSIDE DROP MANHOLE INSTALLATION	CHRISTIAN R. HOFFMAN STATE OF WASHINGTON 42295 REGISTERED PROFESSIONAL ENGINEER EXPIRES: 11/21/2026	SEWER STD. PLAN NO. 6
			REVISION DATE 04/25