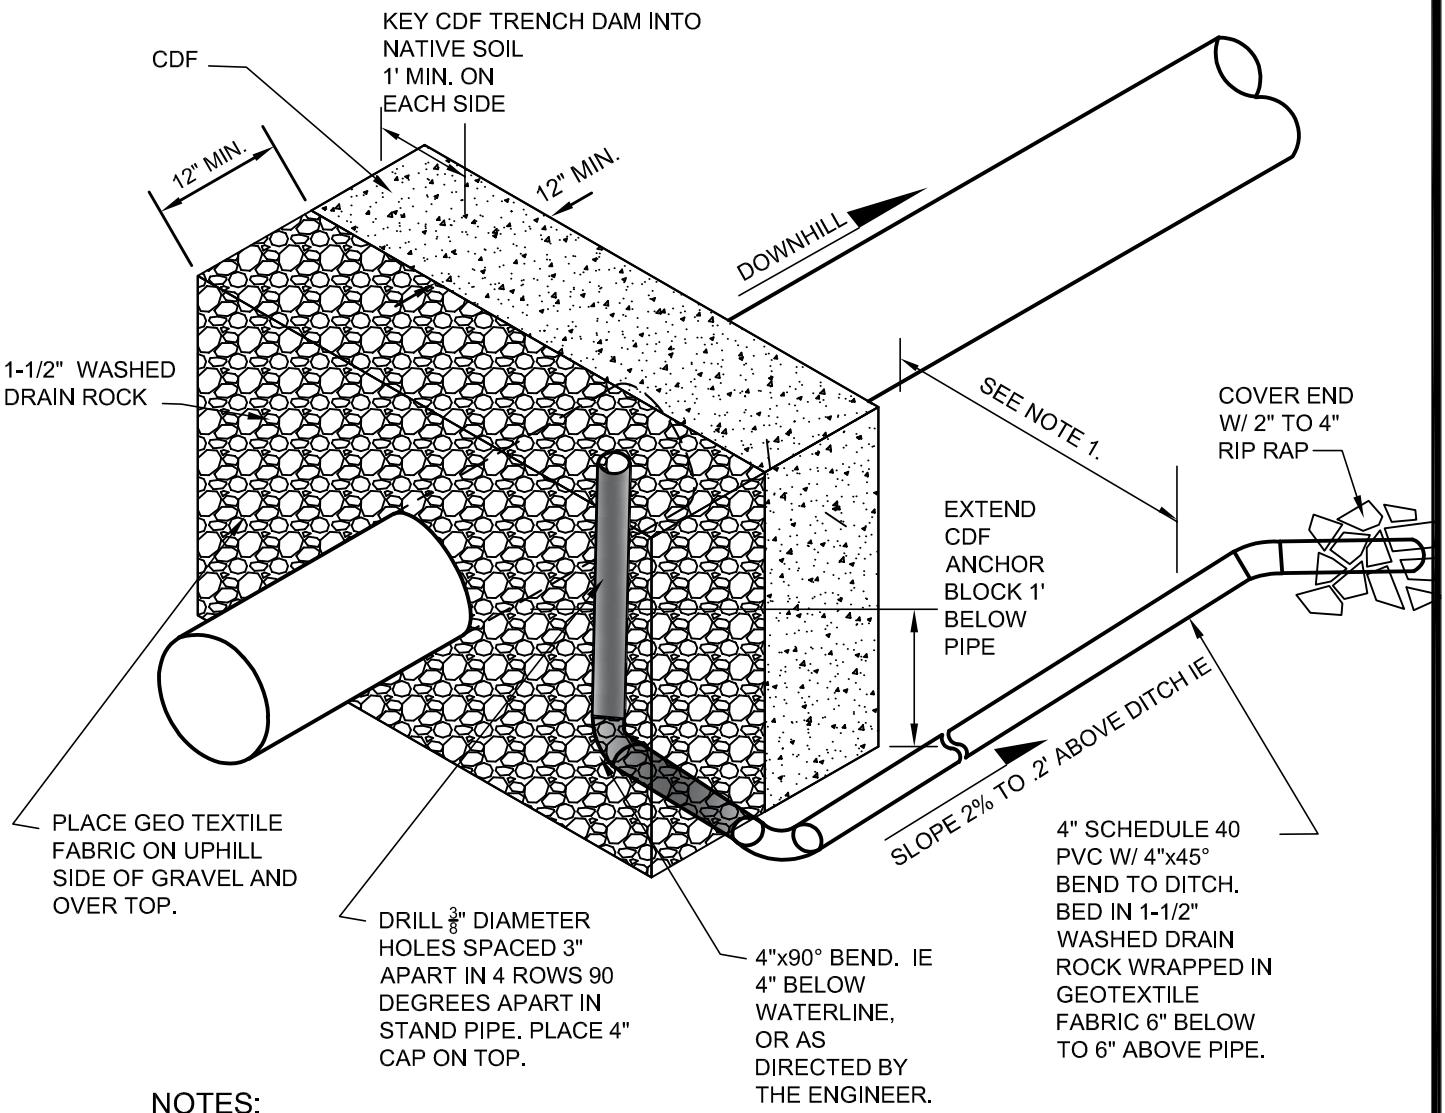

NOTES:

1. 4" PVC DRAIN TO PARALLEL WATERLINE W/ OFFSET BETWEEN PIPES DETERMINED BY THE ENGINEER.
2. PAVEMENT RESTORATION PER CONTRACT DOCUMENTS.
3. GEO TEXTILE FABRIC TO BE WATER PERMEABLE.

TRENCH DAM DETAIL

Woodinville Water District	WATER TRENCH DAM DETAIL	CHRISTIAN R. HOFFMAN STATE OF WASHINGTON 42295 REGISTERED PROFESSIONAL ENGINEER EXPIRES: 11/21/2026	WATER STD. PLAN NO. 27 REVISION DATE 04/25